

PX233-T

Operating Manual



Precision Control, always



Introduction

PX233-T is a Dual Line Digital Timer. It can function in ON / INTERVAL/CYCLIC Timer mode as per configuration. Also, various time ranges can be defined. Dual display can give simultaneous indication of present value and set value. Flat and Thin Surface provides easy cleaning and ensures high level of Hygiene in compliance of HACCP standards.

Field of Application

PX233-T is widely used in:

- Starters / Control Panel
- Moulding Machines
- Textile Industries
- Offset Printing Machines

Caution for your Safety

WIRING: The probe and its corresponding wires should never be installed in a conduit next to control or power supply lines. The electrical wiring should be done as shown in the diagram. The power supply circuit should be connected to a protection switch. The terminals admit wires of upto 2.5sq mm with U-type lugs.

WARNING: Improper wiring may cause irreparable damage and personal injury. Kindly ensure that wiring is done by qualified personnel only.

Maintenance: Cleaning: Clean the surface of the controller with a soft moist cloth. Do not use abrasive detergents, petrol, alcohol or solvents.

Notice: The information in this document is subject to change in order to improve reliability, design or function without prior notice and does not represent a commitment on the part of the company. In no event will the company be liable for direct, indirect, special, incidental or consequential damage arising out of the use or inability to use the product or documentation, even if advised of the possibility of such damages. No part of this manual may be reproduced or transmitted in any form or by any means without the prior written permission of the company.

Controller: Controller should be installed in a place protected by vibration, water and corrosive gasses and where ambient temperature does not exceed the values specified in the technical data.

Dimensions & Panel Cutout




48mm

48mm


Product Mounting

Installation: Fixing and dimensions of panel models:

To fix the unit, slide the fastener ① through the guides ② as per the position shown in the figure. Move the fastener in the direction of the arrow, pressing tab ③ it permits to move the fastener in the opposite direction of the arrow.



48mm


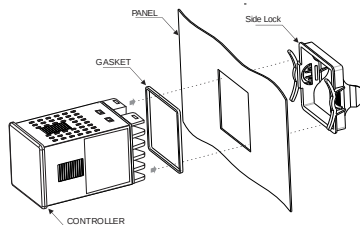


PANEL

GASKET


SIDE LOCK

CONTROLLER

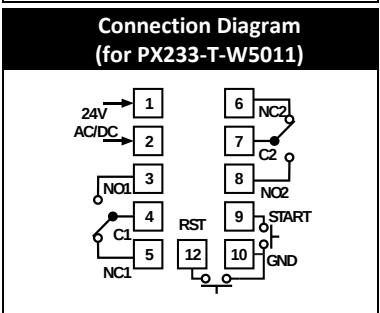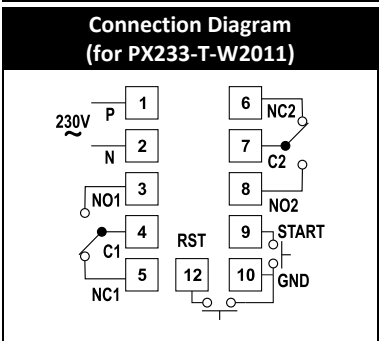

Index		
S.No.	Para	Description
		User Interface
		Technical Specification
		Working
	5P	Set Mode
1	ton	To set On Time in Cyclic / Interval.
2	toF	To set Off Time in Cyclic/On Delay.
	PrG	Program Mode
3	Fnc	To select Timer Function.
4	tyP	To select Input Type.
5	tu/tu	To select unit for toF in on Delay or ton in cyclic /Interval mode.
6	rS/rS	To select resolution for toF in on Delay or ton in cyclic /Interval mode.
7	tu	To select unit for toF in cyclic mode
8	rS	To select decimal point for toF in cyclic mode.
9	nL	To select no. of cycles in cyclic mode.
10	dir	To select timer counting direction.
11	FPS	To select front panel, START.
12	FPr	To select front panel RESET.
13	PO	To select option of Power ON Reset.
14	FL	Keypad lock for Programming mode parameter.
15	SE	Keypad lock for Set Mode parameter.
16	FS	Revert to factory Set Parameter.
		LED Indication

User Interface

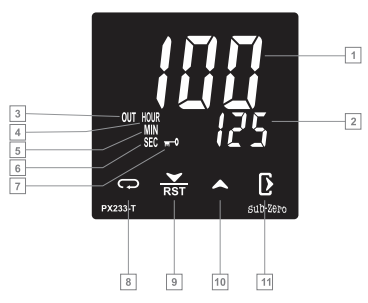

1

2

3

4

5

6

7

8

9

10

11

S.No.	Description
1	Process Time Displays presents process time.
2	Set Time Normal Mode: Display Set time (ton/toF). Programming Mode: Displays set value of parameter.
3	OUT Turns ON while Output cycle is on and also indicates control output is ON.
4	HOUR Timer is configured in hours unit.
5	MIN Timer is configured in minute unit.
6	SEC Timer is configured in second unit.
7	LOCK Turns ON when keypad is locked.
8	Next Key: Used to enters parameters level, moves to next parameters. Press & release this key within 2 seconds to enter in set point mode. Press & hold this key atleast 3 seconds to enter in Programming Mode.
9	Down / Reset Key: Down Key: Used in Program mode to decrement parameter value. Reset Key: If pressed for 3 seconds used to reset the timer from front panel.
10	Up Key: In Normal Mode: If pressed for 2 seconds second display shows no of cycles completed. (If nCL parameter is set non-zero value in cyclic function) To exit press up key again or wait for timeout of 30 seconds, it will move back to Normal Mode and second display will show set time. In Program Mode: Used in Program mode to increment parameter value.
11	Start / Exit Key: Exit Key: Press this key to save the setting value and to exit the programming mode. Start Key: If pressed for 3 seconds in normal mode to simulate start pulse from front panel. NOTE: Only applicable for Pulse Type.

Technical Specification

Housing	: Polycarbonate Plastic
Dimensions	: Frontal: 48 X 48 mm Depth: 78 mm
Panel cutout	: 45.5 X 45.5 mm
Mounting	: Flush panel mounting with fasteners
Protection	: IP65 Front
Connections	: Terminal connectors. < 2.5sq mm terminal only with U-type lugs.
Display	: 3 X 17mm 7 segment White display 3 X 8mm 7 segment Green display 5 Iconic LEDs for Indication

Data Storage	: Non-volatile flash memory
Operating Temperature	: 0°C to 60°C (non-condensing)
Operating Humidity	: 20% to 85% (non-condensing)
Storage Temperature	: -25°C to 60°C (non-condensing)
Power Input	: 230 Vac $\pm$ 15 %, 50/60Hz, 12/24Vdc on request.
Control Output	: 2 c/o SPDT Relay:5A, 230V AC (Resistive)
Input Type	:
Start Input	: Pulse Type: Remote (Potential Free) Front (Configurable) Gate Type: Remote (Potential Free)
Reset Input	: Remote (Potential Free) Front (Configurable) On Power Interruption
Resolution	: 9.99/99.9/999sec, 9.99/99.9/999 Min, 9.99/99.9/999 Hours
Accuracy	: $\pm$ 0.05% of set time/ 50 m sec whichever greater
Counting Direction	: Up/Down (Programmable)

Working

Depending upon Input type Gate or Pulse there are four different modes in Timer: Cyclic ON, Cyclic OFF, On Delay, Interval

Type:

1)Pulse: It works in two approach.

a) Impulse: Every time timer will start once pulse is sent even after reset.

b) Continuous: In this mode pulse will be continuously present. And timer will restart counting after reset pulse.

2) Gate: Timer counts pauses during gate signal applied and resumes once gate signal is removed.


Function:

a) **For Input Type: Start Pulse**

Cyclic ON (Con)

- Timer signal (output cycle) will On for ton period and will Off for toF period.
- Signal starts on start Pulse.
- Signal starts with ON cycle.
- During cycle if reset Pulse is sent then signal will be Off.
- And will not start until new Start Pulse is sent.


Cyclic ON Mode:

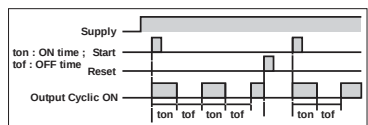

Cyclic OFF (CoF)

- Timer signal (output cycle) will On for ton period and will Off for toF period.
- Signal starts on start Pulse.
- Signal starts with OFF cycle.
- During cycle if reset Pulse is sent then signal will be Off.
- And will not start until new Start Pulse is sent.


Cyclic OFF Mode:

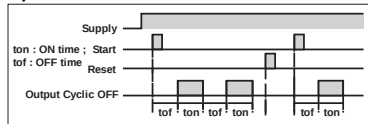


On Delay (on)

- Timer signal(output) will start on START pulse.
- Signal start with OFF state for toF period.
- Once toF delay period overs, Timer cycle remains in ON state, unless "RESET" or "START" pulse is sent.
- After "RESET" Timer signal will start only after START pulse is generated.

On Delay Mode:

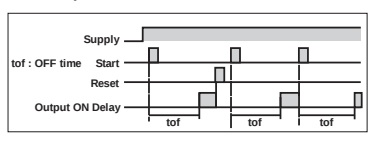


On Delay Mode with continuous Start Signal:



Interval Mode (int)

- Timer signal(output) will start on START pulse.
- Signal start with ON state for ton period.
- Once ton period overs, Output remains in OFF state, unless "RESET" OR "START" pulse is sent.
- After "RESET" Timer signal will start only after START pulse is generated.

Interval Mode:

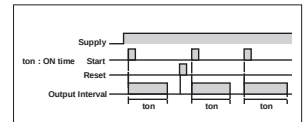


b) For Input Type: Gate Signal

Cyclic ON (Con)

- Timer signal (output cycle) will On for ton period and will Off for toF period.
- Signal starts if and only if gate signal is low.
- Signal starts with ON cycle.
- During cycle if reset Pulse is sent then signal will be restart provided that gate signal is low.
- During cycle if Gate signal is made high then timer counting pauses until gate signal is made low.


Cyclic ON Mode:



Cyclic OFF (CoF)

- Timer signal (output cycle) will On for ton period and will Off for toF period.
- Signal starts if and only if gate signal is low.
- Signal starts with OFF cycle.
- During cycle if reset Pulse is sent then signal will be restart provided that Gate signal is low.
- During cycle if Gate signal is made high then timer counting pauses until gate signal is made low.


Cyclic OFF Mode:



On Delay (on)

- Timer signal(output) will start if and only if gate signal is low.
- Signal start with OFF state for toF period.
- Once toF delay period overs, Timer signal remains in ON state, unless "RESET" pulse is sent
- After "RESET" Timer signal will restart provided that Gate signal is low.
- During delay period if Gate signal is made high then timer counting pauses until gate signal is made low.


On Delay Mode:



Interval Mode (int)

- Timer signal(output) will start if and only if gate signal is low.
- In ton period, Timer signal is in ON state.
- Once ton period overs, Output remains in OFF state, unless "RESET" OR "START" pulse is sent.
- After "RESET" Timer signal will restart provided that Gate signal is low.
- During delay period if Gate signal is made high then timer counting pauses until gate signal is made low.

Interval Mode:



Set Mode

Press & hold key for 2 secs to enter into Set Mode. SP will be displayed. When the key is released, ton (or) toF will be displayed upon the function selected.

1 ton Function: To set On Time

In case of Cyclic Mode and Interval mode it will show On time cycle value.

Min.	Max.	Fac.
0	999	0

NOTE: Not applicable in On Delay Mode.

2 toF Function: To set Off Time

In case of Cyclic Mode and On Delay mode it will show Off time cycle value.

Min.	Max.	Fac.
0	999	0

NOTE: Not applicable in Interval Mode.

Programming Mode

Press & hold key for 4 sec to enter into Program Mode. PRU will be displayed. When the key is released, FnL will be displayed.

3 FnL Function: To select Function.

User can select any of the four modes – Cyclic On (Con), Cyclic OFF (Cof), On Delay (On) and Interval Mode (int). Please see working details for description of Each Mode.

Min.	Max.	Fac.
Con	Int	Con

- Con - Cyclic On
- Cof - Cyclic OFF
- on - On Delay
- int - Interval Mode

4 tYP Function: To select Input Type.

User can select type of input either Gate or Pulse. Please see working details for description of Each Type.

Min.	Max.	Fac.
PUL	GAT	PUL

- PUL - Pulse Type Input
- GAT - Gate Type Input

5 Function:

- To select unit for ton in Cyclic/Interval Mode. (appeared as tm1 in cyclic mode & tm in interval mode)
- To select unit for toF in On delay Mode. (appeared as tm in On delay Mode)

Here time period unit is configured in sec, min or Hour for On-Cycle in Cyclic/Interval mode and Off-Cycle in On delay mode.

Min.	Max.	Fac.
SEC	HrS	SEC

- SEC - Configured in Seconds
- min - Configured in Minutes
- HrS - Configured in Hours

6 Function:

- To select decimal point of ton in Cyclic mode/Interval mode. (appeared as rS1 in cyclic mode & rS in interval mode)
- To select decimal point of toF in On delay mode. (appeared as rS in On Delay Mode.)

Here decimal point is selected where by adjust the timing range/ resolution of ton in Cyclic mode/Interval mode and toF in On delay mode.

Min.	Max.	Fac.
9.99	999	999

7 tnt Function: To select unit of toF in Cyclic.

Here delay period unit is configured in sec, min or Hour for Off-Cycle.

- SEC - Configured in Seconds
- min - Configured in Minutes
- HrS - Configured in Hours

NOTE: Not applicable in non-cyclic modes.

Min.	Max.	Fac.
SEC	HrS	SEC

8 $rS2$ Function: To select decimal point of toF in Cyclic mode.

Here decimal point is selected where by adjust the timing range/ resolution of toF in Cyclic mode.

Min.	Max.	Fac.
9.99	999	999

NOTE: Not applicable in non-cyclic modes.

9 ncL Function: To select no. of cycles in cyclic mode.

If selected, 0 – Cycle will be continuous.

Between 1 to 999 – No. of cycles will be as per the selected value

Min.	Max.	Fac.
0	999	0

Example:

If selected 10, then On-Off Cycle will repeat for 10 times and then stops and relay will get OFF. (Only Applicable for Cyclic Function)

10 dIr Function: To select timer counting direction.

- If selected, uP - Timer will increment in running mode.
- $d-'n$ - Timer will decrement in running mode.

Min.	Max.	Fac.
$d-'n$	uP	$d-'n$

11 $fP5$ Function: To select for front panel START.

- If selected, YES - Front panel START key will be used to give start pulse.
- no - Front panel START key won't work.

Min.	Max.	Fac.
no	YES	no

12 fPr Function: To select for front panel RESET.

- If selected YES - Front panel RESET key will be used to give Reset pulse.
- no - Front panel RESET key won't work.

Min.	Max.	Fac.
no	YES	no

13 nEn Function: Power ON Reset.

- If selected, nPL - Timer Output Signal will resume on Power ON, where it was stopped during Power OFF, but for pulse type it will not run unless start input is given.
- RLl - Timer Output Signal will resume on Power ON, where it was stopped during Power OFF.
- no - Timer Output Signal will start from beginning depending upon input conditions.

Min.	Max.	Fac.
no	nPL	no

14 $LF6$ Function: To Lock Parameter in Programming Mode.

- If selected, LLl - not possible to change any parameter in Programming Mode.
- uLL - Possible to change parameter in Programming Mode.

Min.	Max.	Fac.
uLL	LLl	uLL

Hence, no one can alter any parameter in Programming Mode.

15 SEt Function: To Lock Parameter in Set Mode.

- If selected, LLl - not possible to change any parameter in Set Mode.
- uLL - Possible to change parameter in Set Mode.

Hence, no one can alter any parameter in Set Mode.

Min.	Max.	Fac.
uLL	LLl	uLL

16 $F5$ Function: Revert to factory Set Parameter.

- If selected, YES - Default parameter settings will be retrieved.
- no - Default parameter settings won't be retrieved.

Min.	Max.	Fac.
no	YES	no

LED Indication

LED STATUS DESCRIPTION

LED	STATUS	DESCRIPTION
OUT	ON	Output Cycle & both Relays will be ON.
	OFF	Output Cycle & both Relays will be OFF.

SEC	ON	Timer configured in seconds.
	FLASHING (for 500ms)	Timer running in seconds.

MIN	ON	Timer configured in minutes.
	FLASHING (for 500ms)	Timer running in minutes.

HOUR	ON	Timer configured in hours.
	FLASHING (for 500ms)	Timer running in hours.

M-O	STEADY	Normal Mode: Either or both Programming Mode & Set Mode parameters are locked.
	FLASHING	Set Mode: Keypad is locked. Programming Mode: Keypad is locked.

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

Hid	FLASHING (for 2 seconds with Process Time)	Timer is paused during gate type selected.
-----	--	--

OTHER PRODUCTS



Precision Control, *always*

Digital Panel Meter
Power Analyzer
PID, Counter, PLC,
HMI, Data Logger

03 / 18.03.2020