



DEPARTMENT OF INDUSTRIES & COMMERCE HARYANA
GOVT. QUALITY MARKING CENTRE FOR ENGG. & CHEMICAL GOODS
INDUSTRIAL ESTATE, (Double Storey), SONIPAT-131001

TEST REPORT

S. No.

10409 (NABL ACCREDITATION TESTING LABORATORY TC-9886)

Reference No. QMC/SNP. 2021-22/373

Date. 25/11/2021

Issued to.....
M/s Vriton Fire Protection, B-7 Jain Nagar Extn., Near Sanskrit Pathshala, Karala,
New Delhi - 110081

With Ref. to Letter No. NTI..... Dated. 28/10/2021

Sample described as.....
Wooden Fire Door of size - 1200mm(W) X 2400mm(H); 50mm Thick with Hardware.....
Manufacturer: M/s Vriton Fire Protection, New Delhi-110081

Tested as per Specification..... IS: 3614 (Part-2) - 1992, BS: 476 (Part-20 & 22) - 1987

Lab Sample No.

335

Sr. No. Particulars of Tests Required Value Observed Value

Make :

VRITON

Size of Fire Door :

Wooden Fire Door Single Leaf Type
Door Size 1200 mm (W) x 2400 mm (H), 50mm Thick

Test Criteria:

Stability - Yes
Integrity - Yes
Insulation - Yes

Hardware

The door tested with SS Ball Hinges, Door Closer, Panic Bar, External Trim, Mortise Dead Lock with 80 mm Cylinder Make Vriton, Clear Wired Vision Panel 200x300mm thickness 6.5mm Make Pilkington.

Test Results

The Wooden Single Leaf fire door and all hardware assembly withstood the standard fire exposure with respect to three criteria of Stability, Integrity & 120 minutes of Insulation as per IS: 3614 (Part-2) - 1992 & BS 476 (Part 20 & 22) - 1987. The sample passes the test for 120 minutes (2 hours).

Tested By: [Signature]

[Signature]
Joint Director




Govt. Quality Marking Centre for
Engg. Chemical Goods, Sonapat

- Note:**
- (1) This test report refers only to the particular sample submitted for test.
 - (2) This test certificate may not be reproduced or published in full or in an abstract form without obtaining written permission from this centre.
 - (3) The counter sample will be destroyed after one month of issue of this report.
 - (4) The sample has been submitted by the party and not drawn by this centre.
 - (5) This test report is not for legal Purpose

Attached with Test Report No. 101069 on dated 25/11/2021:

1200 MM

120 Minutes Fire Rated Wooden Door

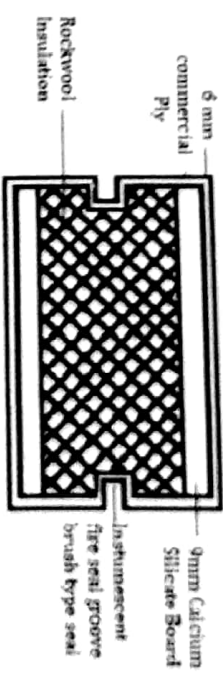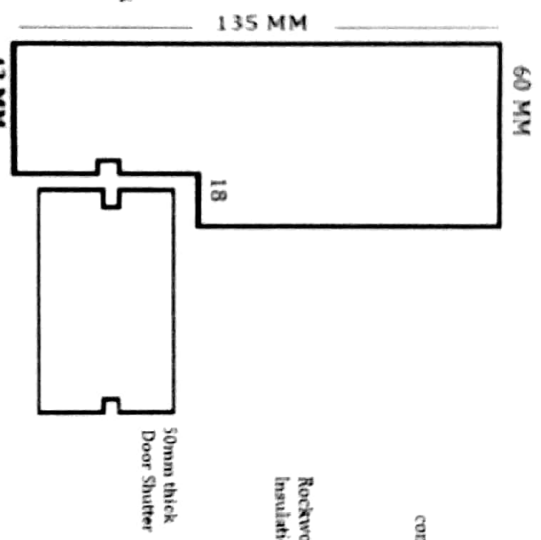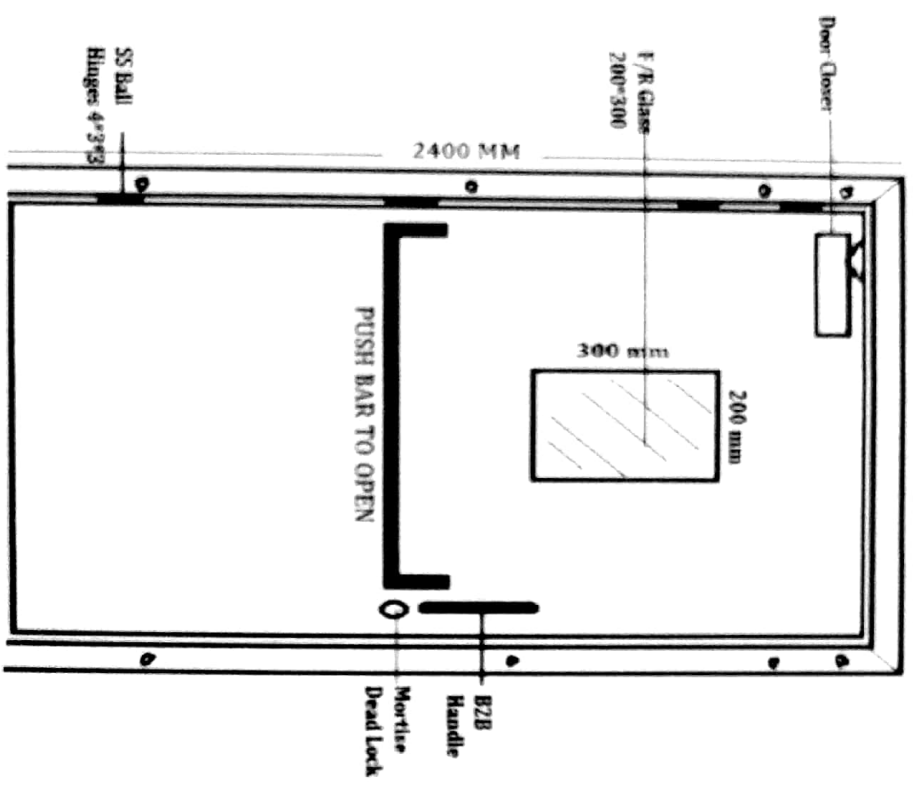

Joint Director
 Govt. Quality Marking Centre for
 Engg. Chemical Goods, Sonapat

Manufactured By:
M/s Vriton Fire Protection
 Add: Plot No. 510, Kanhawala Industrial
 Area, Delhi - 110081
 Contact Person : Mr. Vishnu Kumar Tiwari
 Mobile : 9811724655, 9811724155
 Email : vishnufiredoors78@gmail.com
 GST : 07AEBPT8512M272