

DEPARTMENT OF INDUSTRIES & COMMERCE HARYANA



DIRECTORATE OF MICRO, SMALL & MEDIUM ENTERPRISES

GOVT. QUALITY MARKING CENTRE FOR ENGG. & CHEMICAL GOODS

INDUSTRIAL ESTATE, (Double Storey), SONIPAT-131001

TEST REPORT

S. No. 010

(NABL ACCREDITATION TESTING LABORATORY TC-9886)

Memo No. QMC/SNP 2022-23/90 Date 17/05/2022

Issued to M/s Vriton Fire Protection, B-7, Jain Nagar Extn., Near Sanskrit Pathshala, Karala, N.Delhi-81.

With Ref. to Letter No VFP/2022/05 Dated 13/05/2022

Sample described as Double Leaf Steel fire Glazed Check Door Size 1500mm (W) x 2400 (H.) x 55mm Thick

Tested as per Specification IS: 3614 (Part-I & II); IS: 3809 & BS: 476 (Part-20 & 22)

Lab Sample No. 32

Sr. No.	Particulars of Tests	Required Value	Observed Value
---------	----------------------	----------------	----------------

Make :- VRITON

Manufacturer:- M/s. VRITON FIRE PROTECTION

Type & Size of the Door:-

Double Leaf Steel fire Glazed Check Door Size 1500 mm (W) x 2400mm (H) of 55mm Thickness fitted with 08mm thick glass fire rated " Contraflam doorlite" along with necessary hardware.

Test Results

The sample submitted for testing Double leaf Steel Fire Glazed Check Door to fulfill the requirement of stability & Integrity with radiation Control for 15 minutes Insulation as per IS: 3614 Part-I & I, IS: 3809 I & BS: 476 Part 20 & 22. For 120 minutes fire rating test.

Remarks:-

The Sample Passes The Test For 120 Minutes Fire Rating As Per Above Mentioned Codes.

Tested By: *[Signature]*

[Signature]
Joint Director
Govt. Quality Marking Centre for
Engg. Chemical Goods, Sonapat

- Note:**
- (1) This test report refers only to the particular sample submitted for test.
 - (2) This test certificate may not be reproduced or published in full or in an abstract form without obtaining written permission from this centre.
 - (3) The counter sample will be destroyed after one month of issue of this report.
 - (4) The sample has been submitted by the party and not drawn by this centre.
 - (5) This test report is not for legal Purpose




V RITON FIRE PROTECTION

B-7, Jain Nagar Extn., Near Sanskrit Pathshala, Karala, New Delhi-110081
Ph.011-65682423, Mobile No.: 9811724155
E-mail:-vritonfireprotection2017@gmail.com


Date 13/05/2022

Ref. VFP/2022/05

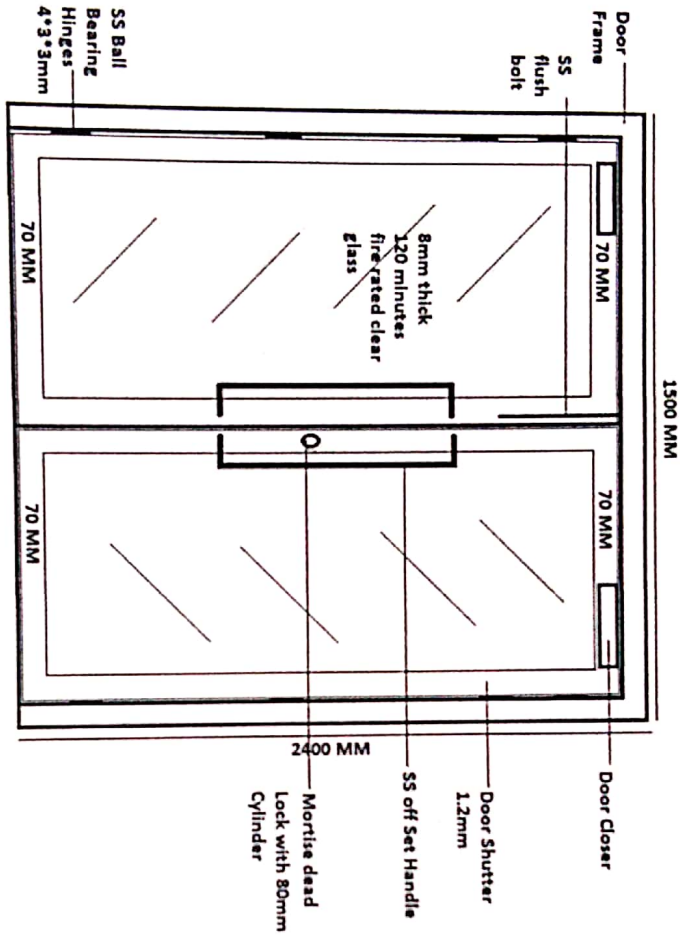

Attached with Test Report No: 010 on dated 17/05/2022.

[Signature]

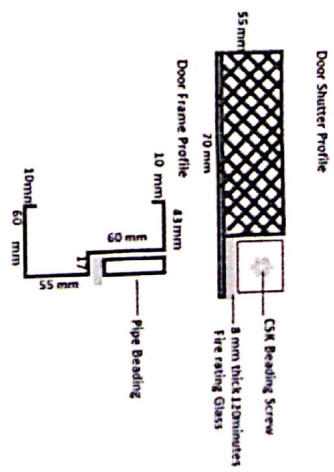

Manufactured By:
 M/s Vriton Fire Protection
 Add : B-7, Jain Nagar Extension, near Sanskrit Pathshala,
 Delhi -110081
 Contact Person : Mr. Vishnu Kumar Tiwari
 Mobile No. 9811724155
 Email : vishnufiredoors78@gmail.com

FOR VITON FIRE PROTECTION

Attested

Vishnu . Kumar
Auth. Signatory

Joint Director

Govt. Quality Marking Centre for
Engg. Chemical Goods, Sonapat